




**RESIDENTIAL  
PRODUCT SPECIFICATIONS**

Bulletin No. 210653  
September 2015  
Supersedes September 2012



**AFUE up to 82.7%**  
**Heating Input - 75,000 to 299,000 Btuh**

**MODEL NUMBER IDENTIFICATION**

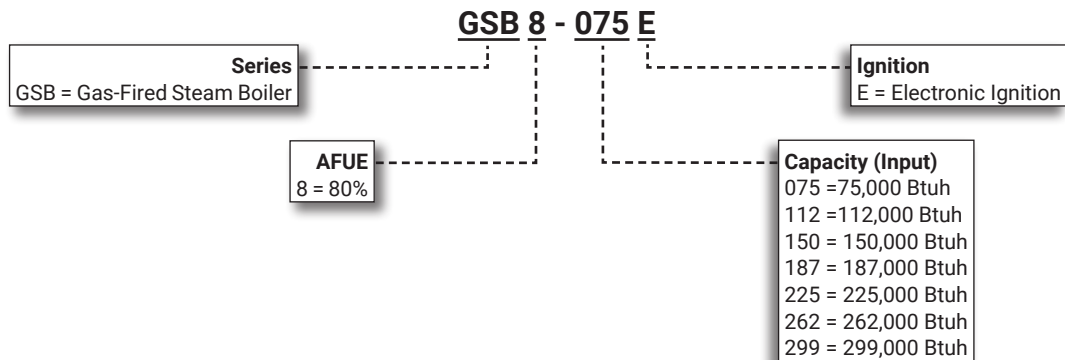

**NOTE - GSB8-E BOILERS ARE NOT AVAILABLE IN CANADA!**

## CONTENTS

Approvals And Warranty . . . . .	2
Dimensions . . . . .	5
Features . . . . .	2
High Altitude Derate . . . . .	4
Installation Clearances . . . . .	5
Optional Accessories . . . . .	4
Specifications . . . . .	4

## APPROVALS AND WARRANTY

### APPROVALS

- AHRI Certified
- Annual Fuel Utilization Efficiencies based on US DOE test procedures and FTC labeling regulations
- Certified by CSA International
- Boiler heat exchanger assemblies are constructed and hydrostatically tested in accordance with American Society of Mechanical Engineers (ASME) Boiler and Pressure Vessel Code Section IV Standards for cast iron heating boilers

### WARRANTY

- Cast iron boiler assembly:
  - Limited twelve years in residential applications only
  - Limited one year in non-residential applications
- All other covered components:
  - Limited five-years in residential applications
  - Limited one year in non-residential installations

**NOTE** - Refer to Lennox Equipment Limited Warranty certificate included with unit for specific details.

## FEATURES

### APPLICATIONS

- Seven models with heating inputs of 75,000 to 299,000 Btuh
- AFUE - Up to 82.7%
- Natural gas or LPG/Propane (LPG with optional conversion kit)
- Boilers may be used in a wide variety of applications including standing cast iron radiators, steam air handlers and convectors
- Compact size allows easy installation in a basement or utility room
- Shipped factory assembled with all controls installed and wired
- Each unit factory test operated to ensure proper operation

### HEATING SYSTEM

#### **Cast Iron Boiler Assembly**

- Boiler sections and push nipples constructed of long life cast iron
- Boiler sections and push nipples expand and contract together, providing positive watertight seal
- Boiler components are easily accessible for cleaning and servicing

#### **Electronic Ignition**

- Electronic spark igniter provides positive ignition of pilot burner on each operating cycle
- Pilot gas is ignited and burns during each running cycle (intermittent pilot) of the boiler
- Main burners and pilot gas are extinguished during the off cycle
- Ignition system permits main gas valve to open only when the pilot burner is proven to be lit
- Pilot operation is fully automatic on demand for heat
- Should a loss of flame occur, the main valve closes, shutting down the unit

#### **Automatic Gas Control**

- Silent operating gas controls provide 100% safety shut off
- 24 volt redundant combination gas control valve combines automatic safety pilot, manual shut off option (On-Off), pilot filtration, automatic electric valve (dual) and gas pressure regulation into a compact combination control
- Dual valve design provides double assurance of 100% close off of gas to the pilot and main burners on each off cycle

## FEATURES

### HEATING SYSTEM (continued)

#### Titanium Burners

- Titanium composite burners resist corrosion and oxidation
- Superior strength and longevity

#### Relief Valve

- Furnished as standard for field installation in top of cabinet
- Valve provides for pressure relief of heating system in case of abnormal operating conditions
- Valve opens at 15 psig
- Approved by ASME.

#### Steam Pressure Gauge

- Located in top of unit cabinet
- Gauge monitors system for safe and reliable operation

#### Water Level Gauge

- Furnished on side of unit
- Allows a visual inspection for correct cold water level in the boiler
- Correct level is stamped on cabinet side behind glass tube

#### Brass Drain Valve

- 3/4 in. brass drain valve is furnished for field installation in return piping

### Optional Accessories

#### LPG/Propane Conversion Kit

- Conversion kit required for field changeover from natural gas
- Kits available for standard and high altitude operation
- See Specifications tables

### VENTING

#### Blocked Vent Shutoff Sensor

- Temperature sensitive fusible-link device prevents unit operation in case of flue blockage
- Sensor is furnished as standard and factory installed at the relief opening of the draft diverter

#### Vent Damper

- Motorized vent damper electrically interlocks with the gas ignition system to increase efficiency of heating system by reducing loss of heated air up the chimney after burner shut off
- Also reduces chimney infiltration during boiler off cycle
- Furnished as standard for field installation

### CONTROLS

#### Flame Rollout Switch

- Temperature sensitive fusible-link device is furnished and factory installed on the boiler base just outside of the burner box
- Fuse prevents unit operation in the event combustion products passageway through the flueway is reduced or blocked

#### Steam Pressure Limit Control

- Factory installed control gives protection against abnormal operating conditions
- Adjustable control automatically shuts off gas to the burners if steam pressure reaches cut-off setpoint
- Factory installed on side of unit cabinet

#### Low Water Cut-Off

- Electronic probe type control automatically shuts off gas to the burners if water level drops below minimum safe levels
- Factory installed in boiler

### Optional Accessories

#### Thermostat

- Thermostat is not furnished with unit
- Lennox Price Book for selection

### CABINET

- Heavy gauge steel
- Baked-on enamel paint finish
- Fully insulated with fiberglass insulation, keeping cabinet surface temperatures low
- Controls are shipped factory installed on right side of cabinet and may be field relocated to left side of cabinet
- Supply and return steam lines are furnished on both sides of cabinet
- Plugs are furnished for unused side
- Burner access panel is easily removed for servicing
- Integral draft diverter is part of unit cabinet

#### Transformer/Wiring Junction Box

- 24 volt control transformer and wiring junction box is furnished on side of unit cabinet for field wiring connections

## SPECIFICATIONS

Model No.				GSB8 -075E	GSB8 -112E	GSB8 -150E	GSB8 -187E	GSB8 -225E	GSB8 -262E	GSB8 -299E
<b>Gas Heating Performance</b>	Heating capacity Btuh	Input	Natural gas	75,000	112,500	150,000	187,000	225,000	262,500	299,000
			LPG/Propane	70,000	105,000	140,000	175,000	210,000	245,000	280,000
		Output	Natural gas	62,000	91,000	122,000	153,000	183,000	214,000	245,000
			LPG/Propane	58,000	85,000	114,000	143,000	171,000	200,000	229,000
	<sup>1</sup> Net AHRI I=B=R rating - Btuh		Natural gas	47,000	68,000	92,000	115,000	137,000	161,000	184,000
			LPG/Propane	44,000	64,000	86,000	107,000	128,000	150,000	172,000
	<sup>1</sup> Net AHRI I=B=R rating - sq. ft. radiation		Natural gas	196	283	383	479	571	671	767
			LPG/Propane	183	267	358	446	553	625	717
	<sup>2</sup> AFUE			82.7%	82.0%	82.0%	82.0%	82.0%	82.0%	82.0%
	<b>Boiler Data</b>	Number of boiler sections			3	4	5	6	7	8
Boiler capacity - U.S. gallons		Full		4.2	5.90	7.60	9.30	11.00	12.70	14.40
		Water level		2.6	3.80	5.00	6.20	7.40	8.60	9.80
<b>Connections in.</b>	Flue size diameter (round)			5	6	6	7	7	7	7
	Gas piping	Natural gas		1/2	1/2	1/2	3/4	3/4	3/4	3/4
		LPG/Propane		1/2	1/2	1/2	3/4	3/4	3/4	3/4
	Water supply size			2-1/2 NPT						
	Water return size			2-1/2 NPT						
	Drain size			3/4 NPT						
<b>Electrical characteristics</b>				120 volts - 60 hertz - 1 phase (less than 12 amps)						
<b>Shipping weight - lbs. 1 package</b>				325	404	483	564	649	719	800

## OPTIONAL ACCESSORIES

See Lennox Price Book For Complete Listing of Optional Accessories

LPG/Propane Conversion Kit	Standard Kit	57L60	54L59	54L61	54L63	54L65	54L67	54L69
	High Altitude (over 5000 ft.)	57L61	54L60	54L62	54L64	54L66	54L68	54L70

<sup>1</sup> Net AHRI steam ratings indicate the amount of equivalent direct radiation each boiler will produce under normal conditions and thermostatic control. Steam ratings based on an allowance of 1.333 in accordance with the factors shown on the I=B=R Standard as published by The Hydronics Institute. Selection of boiler size should be based on "Net I=B=R Rating" being equal to or greater than installed radiation in square feet.


<sup>2</sup> Annual Fuel Utilization Efficiency based on US DOE test procedures and FTC labeling regulations.

## HIGH ALTITUDE DERATE

CSA certified units for the U.S. must be derated when installed at an elevation of more than 2000 feet above sea level. If unit is installed at an altitude higher than 2000 feet, the unit must be derated 4% for every 1000 feet above sea level. Thus, at an altitude of 4000 feet, the unit would require a derate of 16%.

**NOTE** - This is the only permissible derate for these units.

## DIMENSIONS

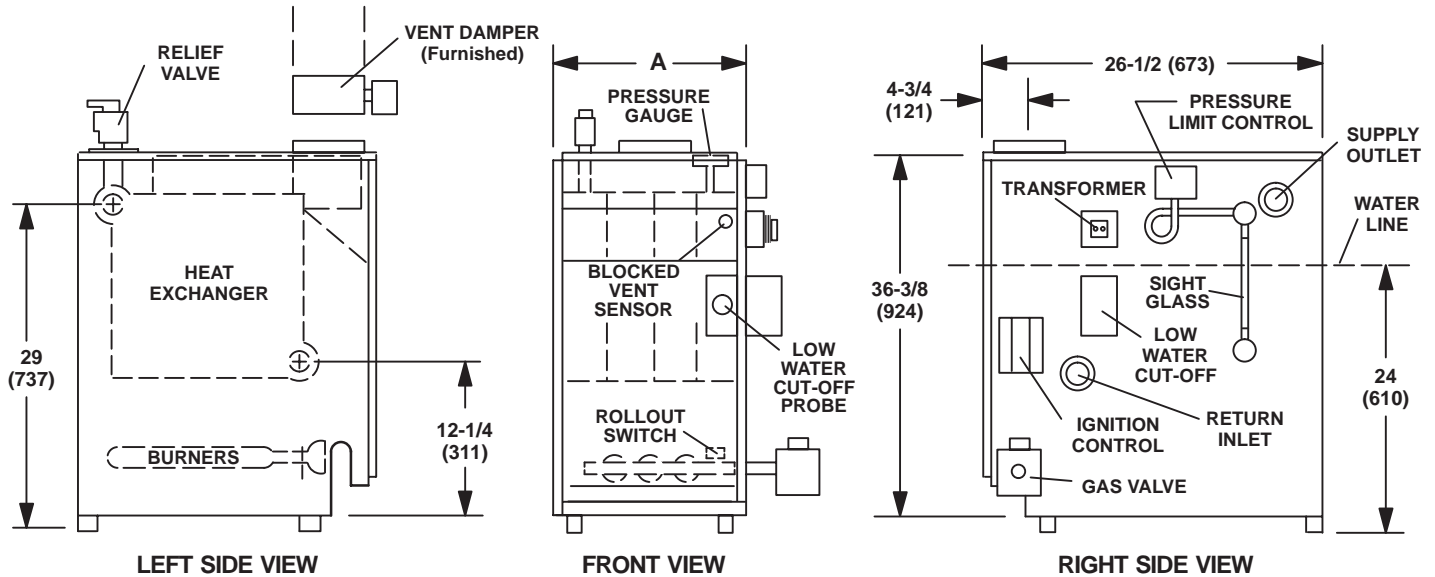

Model No.	A	
	in.	mm
GSB8-75E	11-1/4	286
GSB8-112E	14-1/2	368
GSB8-150E	17-3/4	451
GSB8-187E	21	533
GSB8-225E	24-1/4	616
GSB8-262E	27-1/2	699
GSB8-299E	30-3/4	781

## INSTALLATION CLEARANCES

Side	6 (152)
Gas Supply/Control Side	24 (610)
Rear	6 (152)
Top	6 (152)
Service Clearance (Front)	24 (610)
<sup>1</sup> Floor	*Combustible
Flue Pipe	6 (152)

NOTE - Air for combustion must conform to the methods outlined in the National Fuel Gas Code (NFPA 54/ANSI-Z223.1).

NOTE - Flue sizing must conform to the methods outlined in the current National Fuel Gas Code (NFPA 54/ANSI-Z223.1) or applicable provisions of local building codes.


<sup>1</sup> Clearance for installation on combustible floor if combustible flooring base (field supplied) is installed between the boiler and the combustible floor. See Specifications Tables.





## REVISIONS

Section	Description
Warranty	Warranty for covered components in residential applications has been extended from 1 year to 5 years.



Visit us at [www.lennox.com](http://www.lennox.com)

For the latest technical information, [www.LennoxPros.com](http://www.LennoxPros.com)

Contact us at 1-800-4-LENNOX

NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.

©2020 Lennox Industries, Inc.